

THEORETICAL ECOLOGICAL STUDY -REFRIGERANT COMPARISON-

G. TARLEA M.VINCERIUC¹ A. TARLEA²

Abstract: The present paper is about the refrigerant R32 as an alternative solution for R134a. The thermodynamic properties were determined using the program Refprop. The comparative analysis regarding the TEWI factor was made for an air-water heat pump that currently works on R134a.

Key words: refrigerant, GWP, TEWI factor.

1. Introduction

Because of the more and more severe measures undertaken in order to eliminate HFC and HCFC type refrigerants, synthetic substances which nature cannot rapidly dissociate and which, by accumulating could contribute to global warming and ozone depletion, extensive

research is done, in which various ecological refrigerants are analyzed [1],[2],[3].

The paper presents a comparative study for an air-water heat pump in terms of the contribution of refrigerants to global warming.

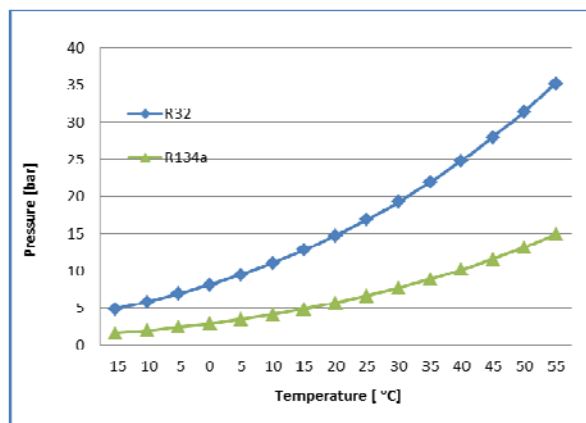


Fig. 1: Pressure refrigerants vs. temperature

Thermodynamic properties of these simulations were determined using RefProp software [8]. From Table 1, it can

be observed that the pressure of R32 is higher, in comparison to R134a's. Figure 1

¹ Technical University of Civil Engineering Bucharest.

² Romanian General Association of Refrigeration.

and Figure 2 show the vapour pressure and density differences on the temperature variation of the proposed refrigerant.

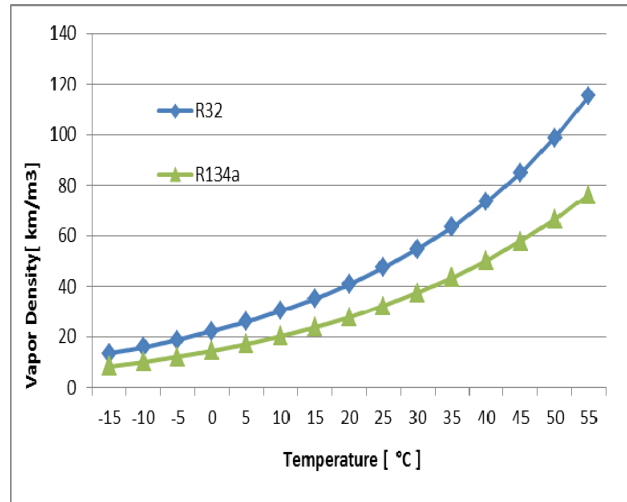


Fig. 2: Vapour Density vs. temperature

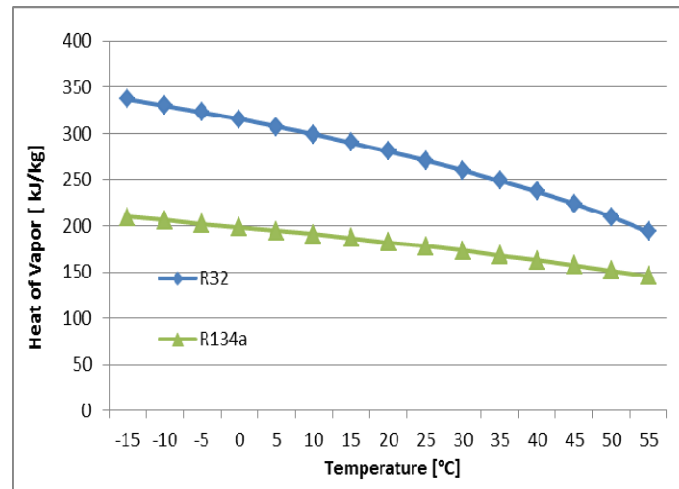


Fig. 3: Heat of vaporization vs. temperature

2. The theoretical study

The study case is for a refrigeration capacity of 0.4 kW. The vaporisation temperature of the refrigeration system is -10°C and the condensation temperature is $+55^{\circ}\text{C}$.

The TEWI factor was calculated according to UE legislation. The total

global warming potential method calculation (GWP) of the Ecological Alternative was done according to REGULATION (EC) No 842/2006 (from 1 January 2015 REGULATION (EC) No 517/2014) [1], [4], [5], [6], and [7].

The TEWI factor was determined respecting the Standard SR EN 378-1:

The following assumptions were made in order to calculate the TEWI factor: mass of Alternative R32 - 0,646kg and 0,780 kg for R134a.:

Comparison between the ecological alternative and R134a Table 1

Refrigerant	R32	R-134a
Critical temperature [°C]	78,105	101,06
Critical pressure [bar]	57,82	40,593
Critical density [kg/m ³]	424	511,9
Molar mass [kg/kmol]	52,024	102,03

The theoretical results

Table 2

Refrigerant	R32	R-134a
Refrigerant charge [kg]	0,646	0,780
ODP	0	0
GWP	650	1300
TEWI Tons of CO ₂	43,37	41,01

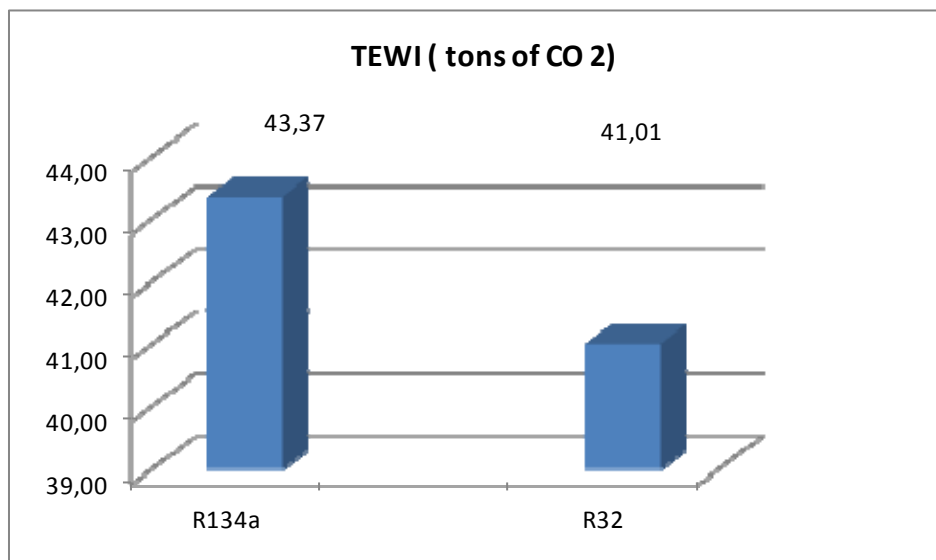


Fig. 4: *TEWI Factor*

The refrigeration system operated 20 hours per day, 200 days per year. The leakage of refrigerant was 8% from charge

with a usual recovery factor. The total operating time of the system was 15 years and CO₂ emissions were 0.6 kg / kWh.

3. Conclusions

The paper shows the advantages and disadvantages of the refrigerant R32, which could replace R134a and could be used in air conditioning equipment.

By comparing the alternatives in Figure 4, Table 2 it is clear that the global warming impact (TEWI) of refrigerant R32 is the lowest and of R134a is the highest.

As a consequence to the determination of the thermodynamic properties, one could observe (Table 1) that the critical temperature is decreasing and the critical pressure is increasing for alternative R32 in comparison with refrigerant R134a.

More information can be required through the following e-mail address: gratiela.tarlea@gmail.com.

References

1. Țârlea G. M.: *Codes of Practice (1,2). Domain refrigerating and air conditioning Bucharest*, Publisher AGIR, 2008, 2009.
2. Țârlea G., Vinceriuc M.: - *Studiul comparativ al pompei de caldura aer-apa utilizand agentii frigorifici R134a si R152a*, in Conferinta nationala de Instalatii, 13-15 octombrie Sinaia 2010.
3. Tarlea G. M., Vinceriuc M - *Agenti frigorifici ecologici – Înlocuitori ai R134a*, In A 47-a conferinta nationala de Instalatii, 17-19 octombrie Sinaia 2012,
4. Țârlea G. M., Vinceriuc M., Tarlea A., Popescu G - *Theoretical Comparative Study Case, Hydrocarbons and HFC Mixture Alternatives Retrofit*, published in The 10 th IIF/IIR Gustav Lorentzen Conference on Natural Refrigerants, Delft, The Netherlands, June 25-27, 2012
5. Țârlea G. M., Vinceriuc M. - *Alternative ecologice de agenti frigorifici pentru o pompa de caldura aer-apa*, in Volumul Conferintei Tehnico- Stiitifica cu participare internationala, „Instalatii pentru constructii si economia de energie”, Editia XXII, 5-6 iulie Iasi 2012, Editura Societatii Academice ”MATEI-TEIU BOTEZ”;
6. ****Regulation (EC) No 842/2006 of the European Parliament and of the council on certain fluorinated greenhouse gases*
7. ****Regulation (EC) No 517/2014 of the European Parliament and of the council on certain fluorinated greenhouse gases*
8. ****The National Institute of Standards and Technology (NIST) - REFPROP V 8.0, Reference Fluid Thermodynamic and Transport Properties.*